



51st FLOOR SOUTH PLAN

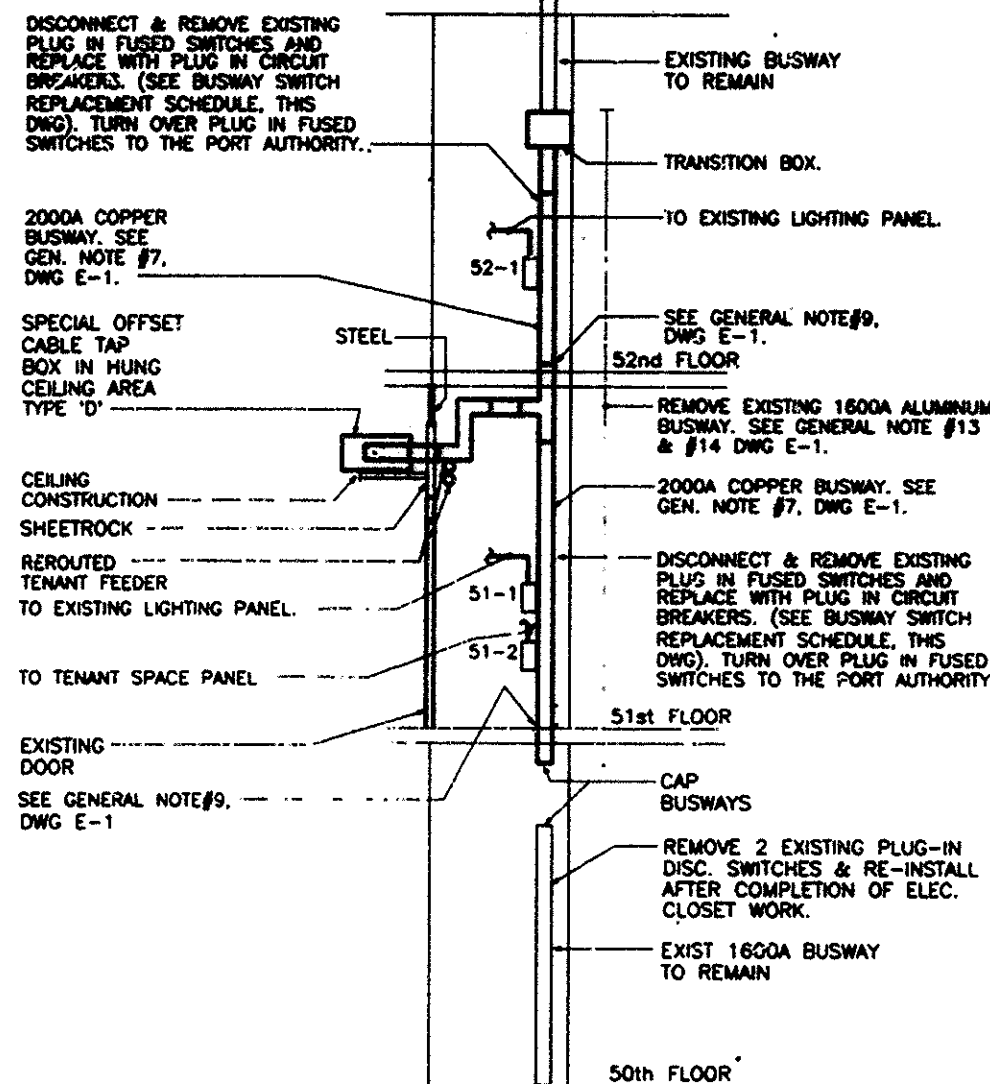


51st FLOOR SECTION A-A & PART RISER


BUSWAY SWITCH REPLACEMENT SCHEDULE						
#	EXIST. SW. SIZE	EXIST. FUSE RATING	NEW BREAKER RATING	NEW FEEDER	NEW COT	REMARKS
52-1	200A	125A	225AF/125AT	4#1 CU	1 1/2"	
52-2	200A	125A	225AF/125AT	4#1 CU	1 1/2"	
51-1	200A	125A	225AF/125AT	4#1 CU	1 1/2"	
32-1	200A	125A	225AF/125AT	4#1 CU	1 1/2"	
32-2	200A	125A	225AF/125AT	4#1 CU	1 1/2"	
32-3	200A	125A	225AF/100AT	4#1 CU	1 1/2"	

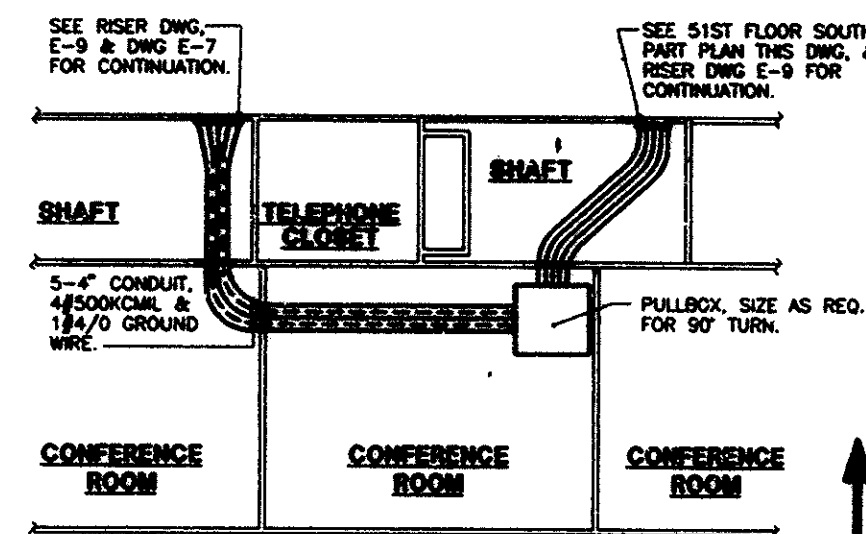


48th FLOOR SOUTH PLAN

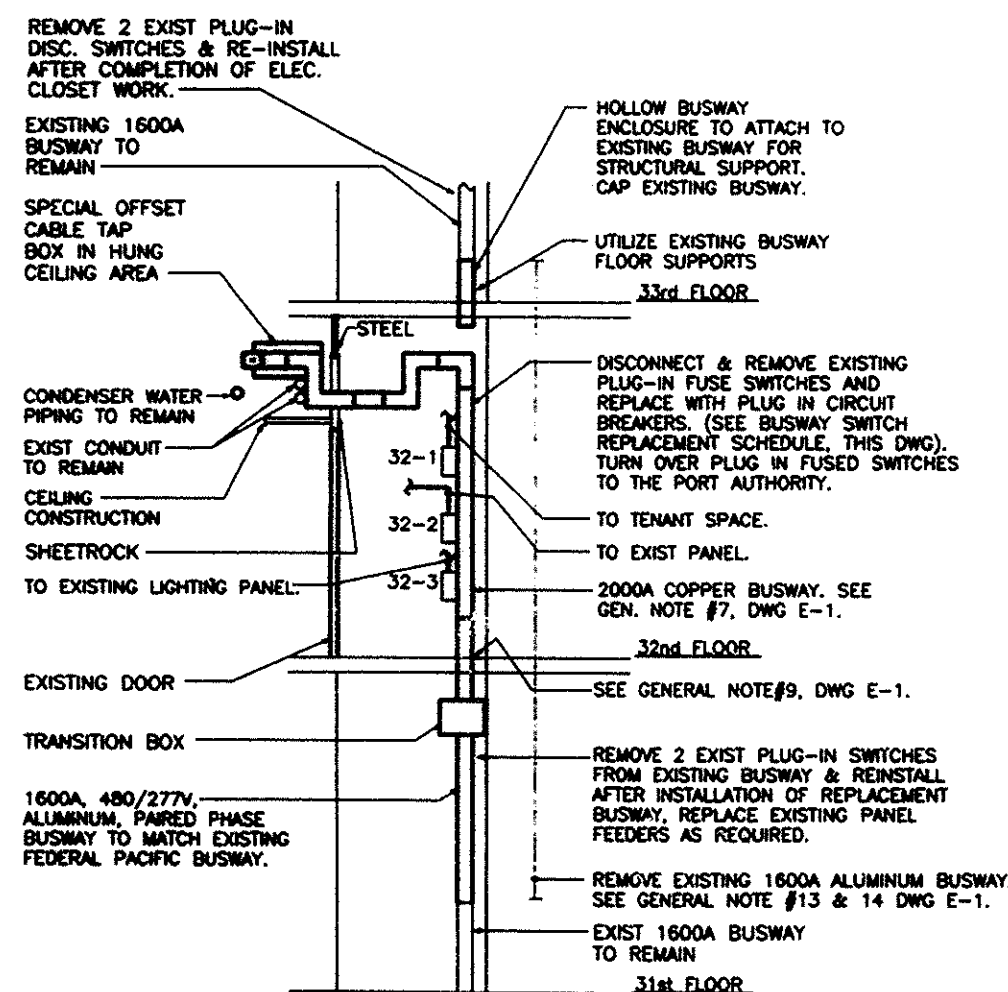

32nd FLOOR SECTION A-A & PART RISER

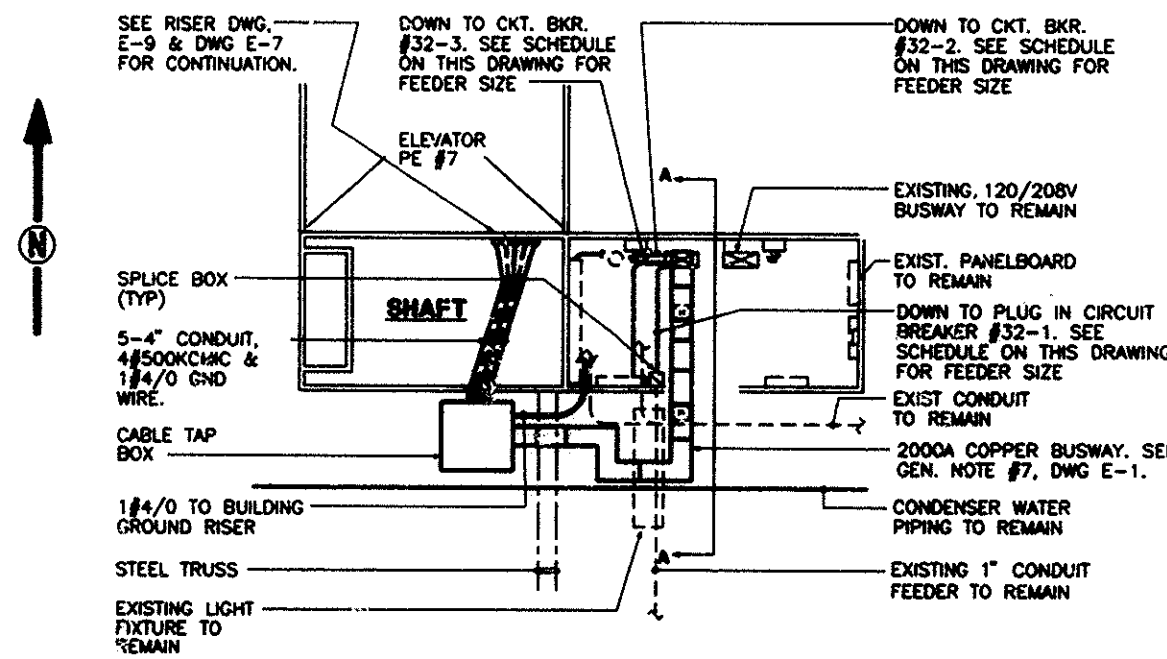

32nd FLOOR SOUTH PLAN

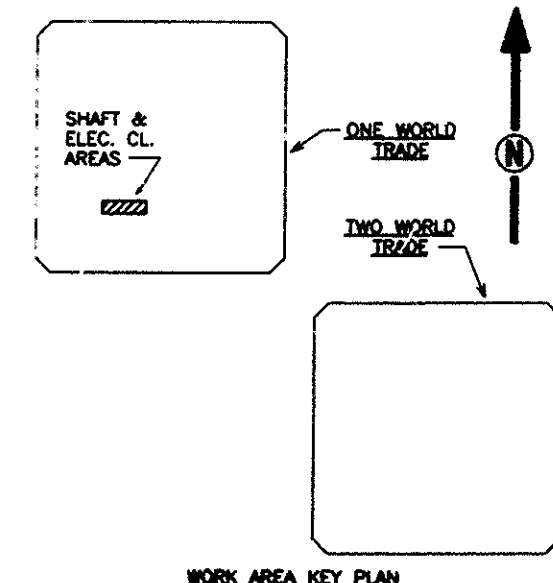

**THE PORT AUTHORITY OF NY & NJ**

**EDWARDS AND ZUCK, P.C.**  
CONSULTING ENGINEERS  
330 West 42nd Street, New York, NY 10036  
212-726-3400  
© 1992 Edwards and Zuck, P.C.



1/15/01 Drawings of Record

**The World Trade Center**  
**Electrical/HVAC**  
**Upgrade Program**

**LOW VOLTAGE DISTRIBUTION**  
**ONE WTC**  
**ELECTRICAL**  
**32ND, 48TH, & 51ST**  
**FLOOR**  
**SOUTH SIDE**  
**ELECTRIC CLOSET PART PLAN**

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without it's written consent.

CJ/CADD MW/CADD F.J.L.  
Designed by Drawn by Checked by  
Date 10/4/93 Scale 1/4"=1'-0"  
Contract Number Drawing Number  
**WTC-804.0-31 E-8**

FILE NAME: PA102038